


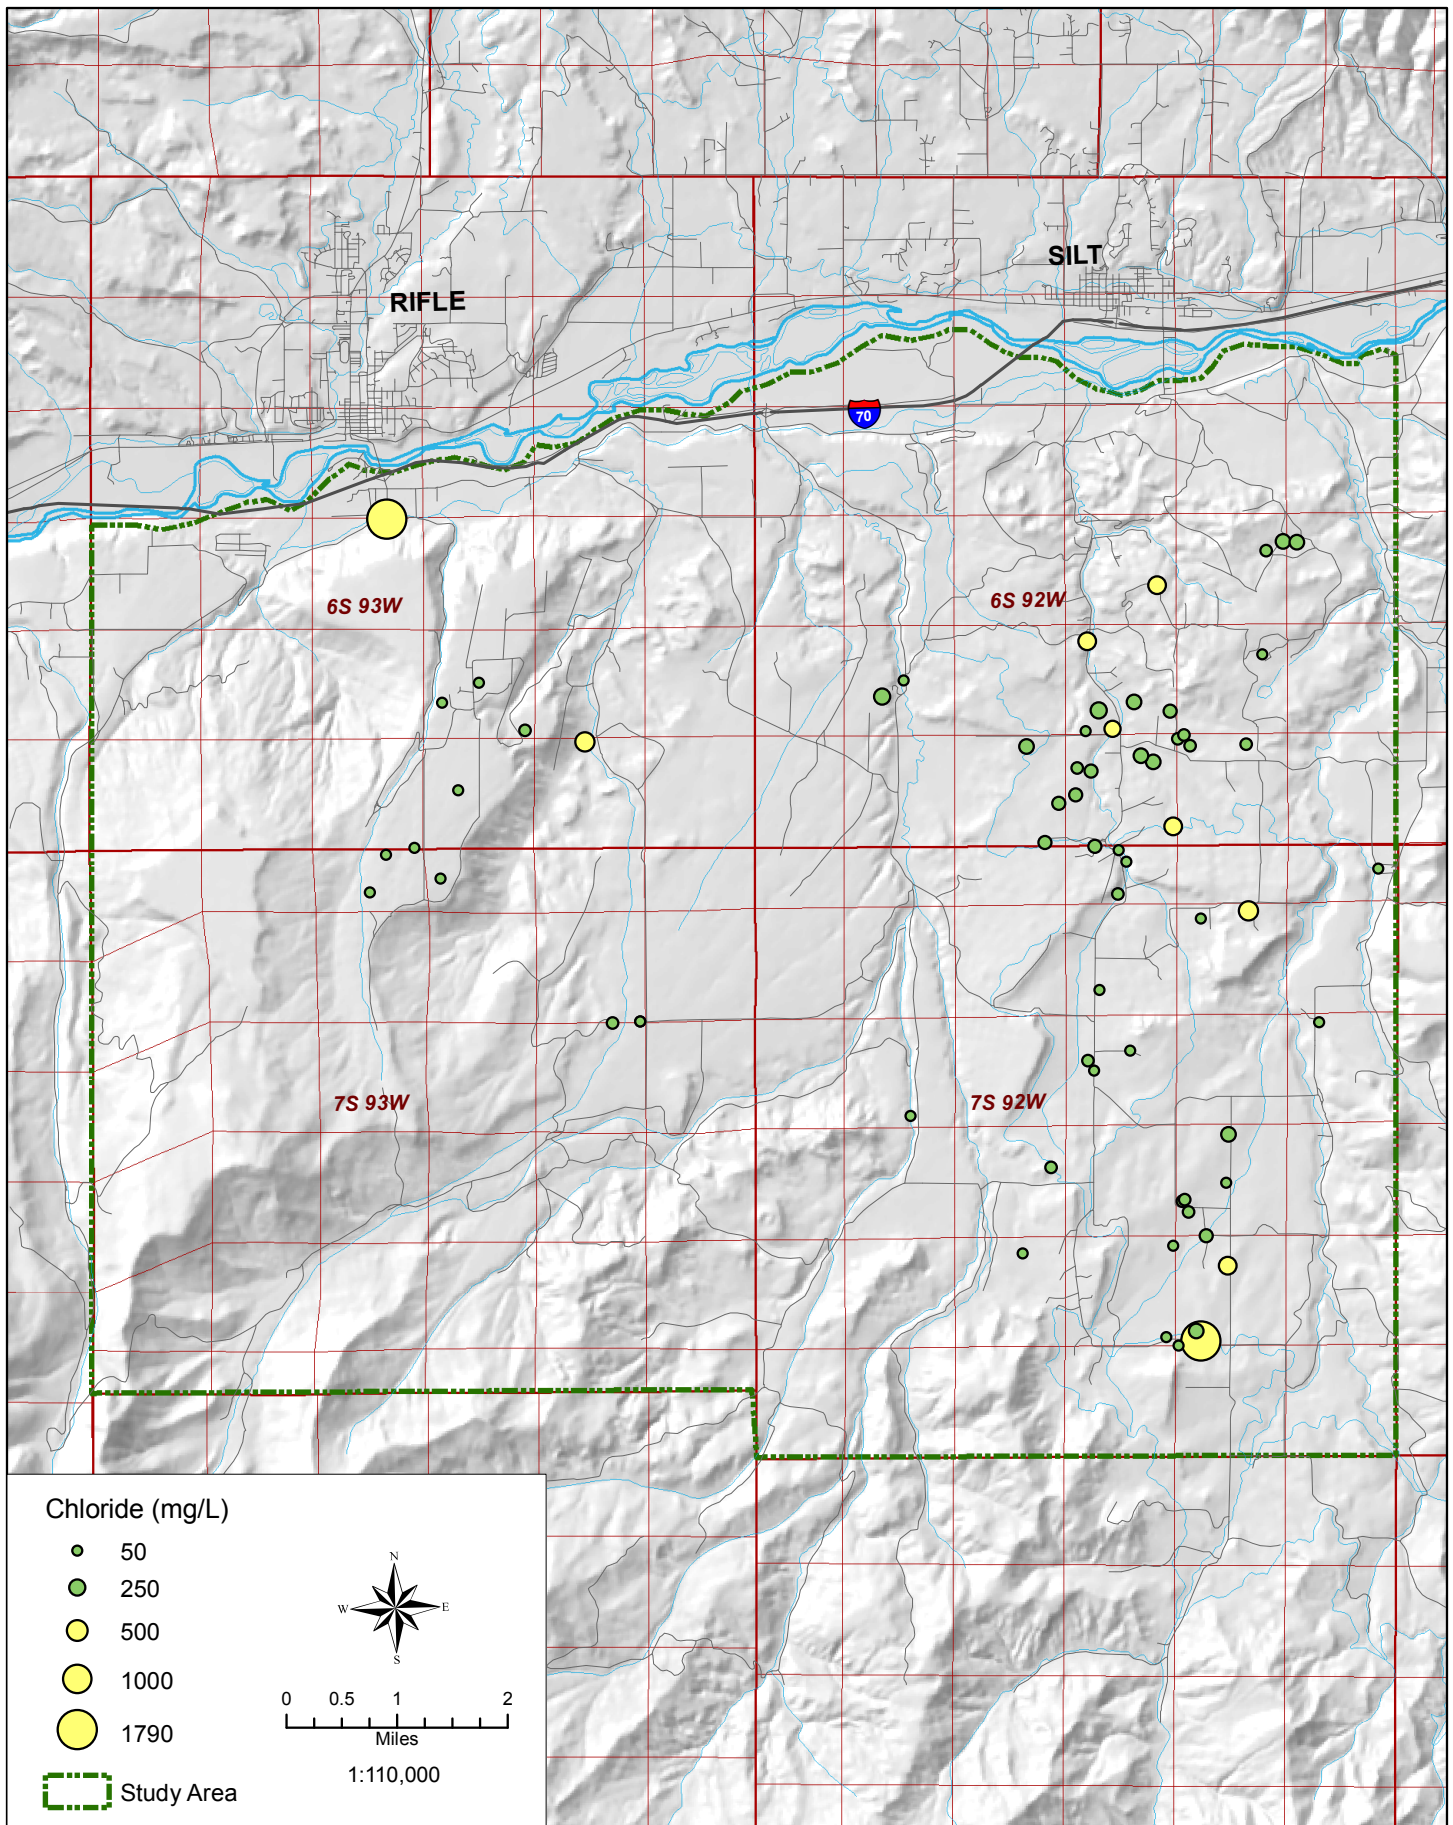

Note: Values > CBGWS standard of 250 mg/L are highlighted in yellow.

**Figure 4.7. Chloride Concentration Distribution in Domestic Wells**