

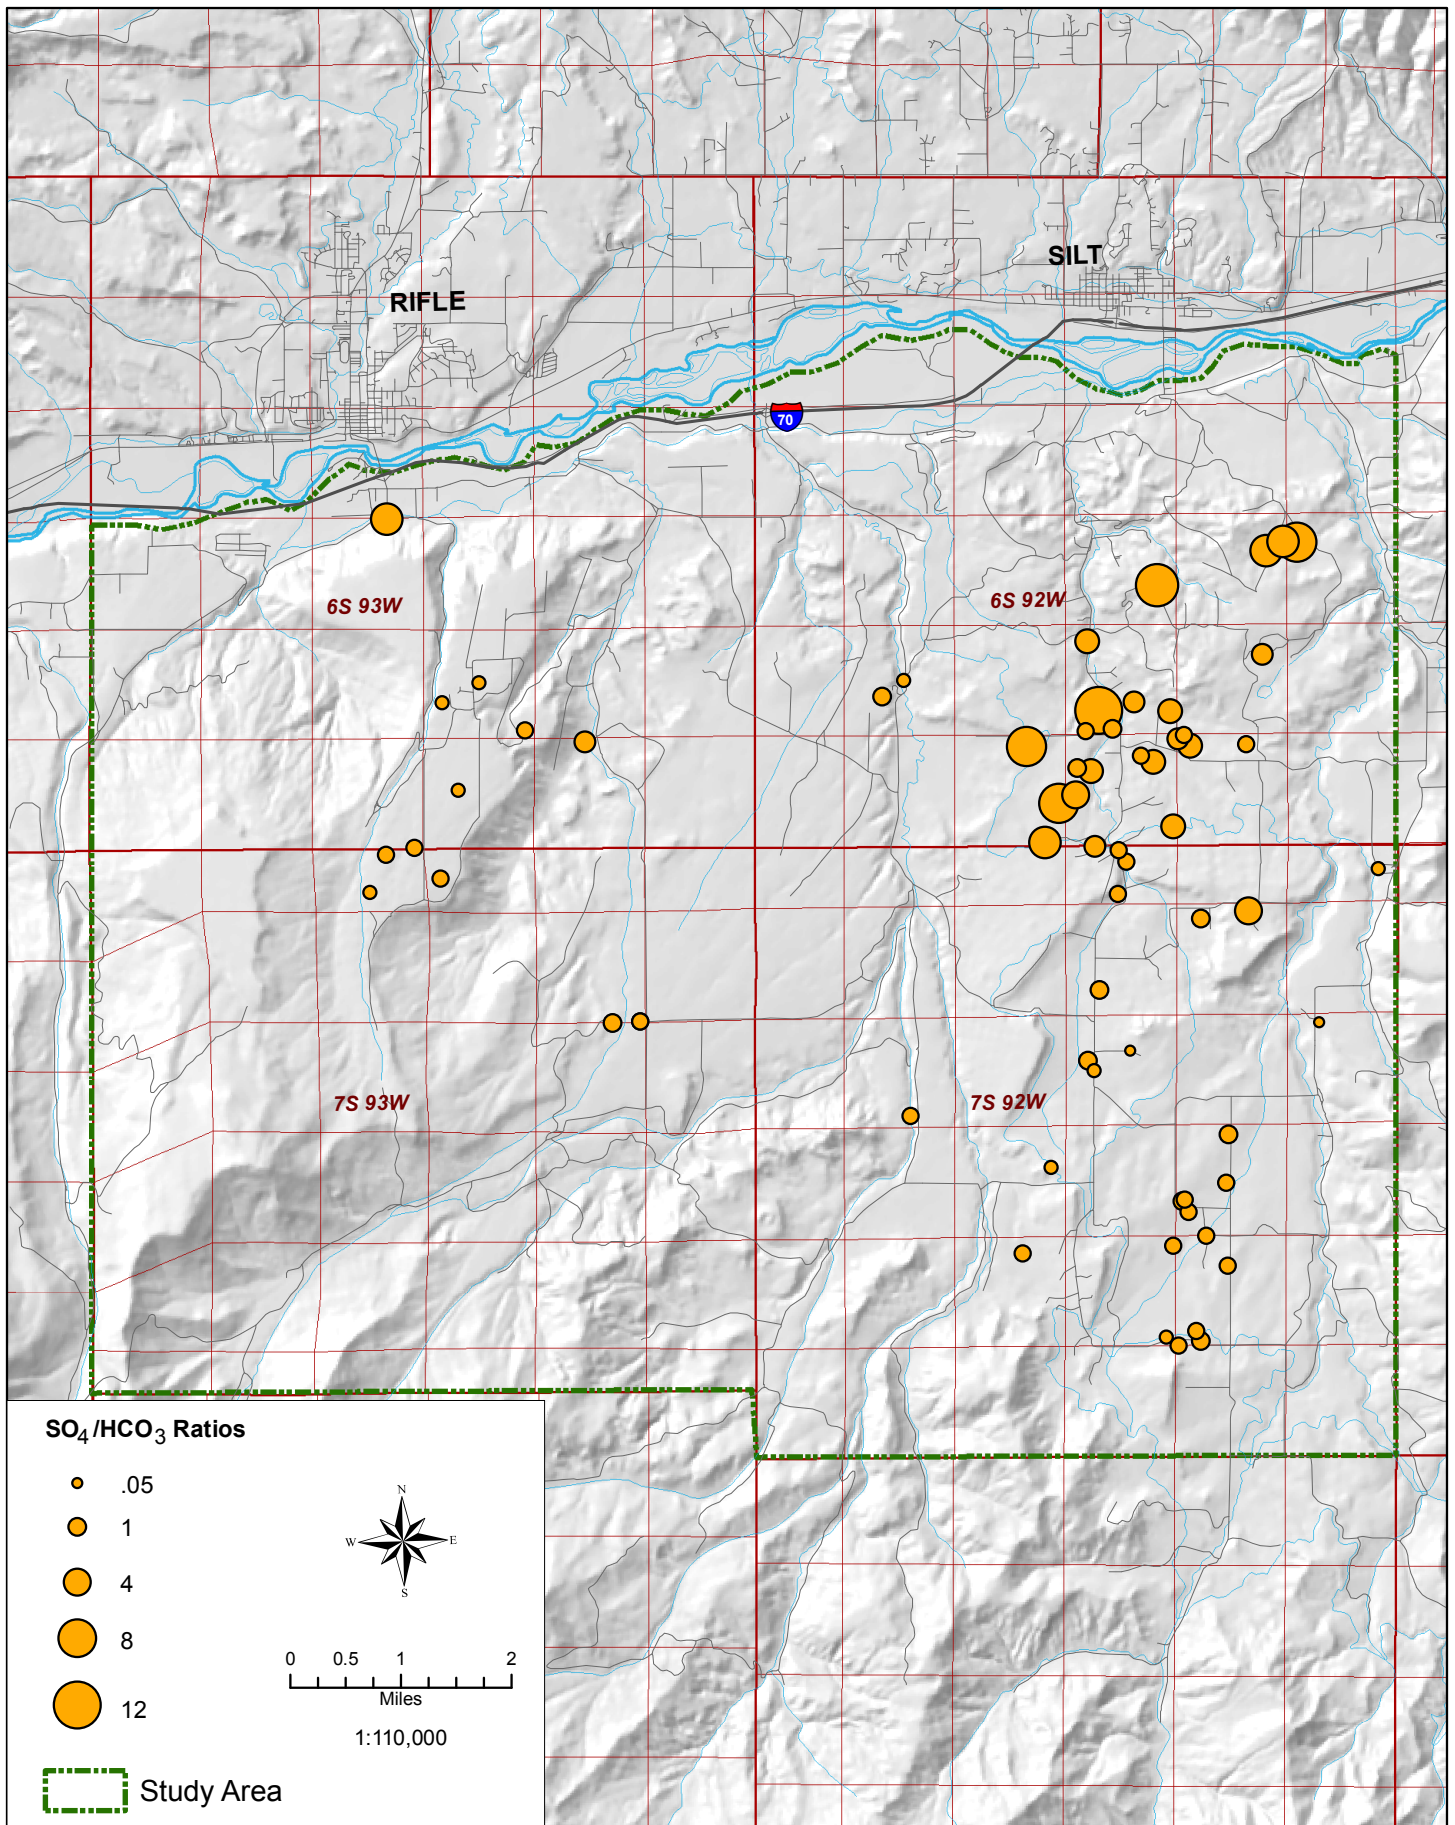


Figure 4.13. SO_4/HCO_3 Ratios for Domestic Well Samples