


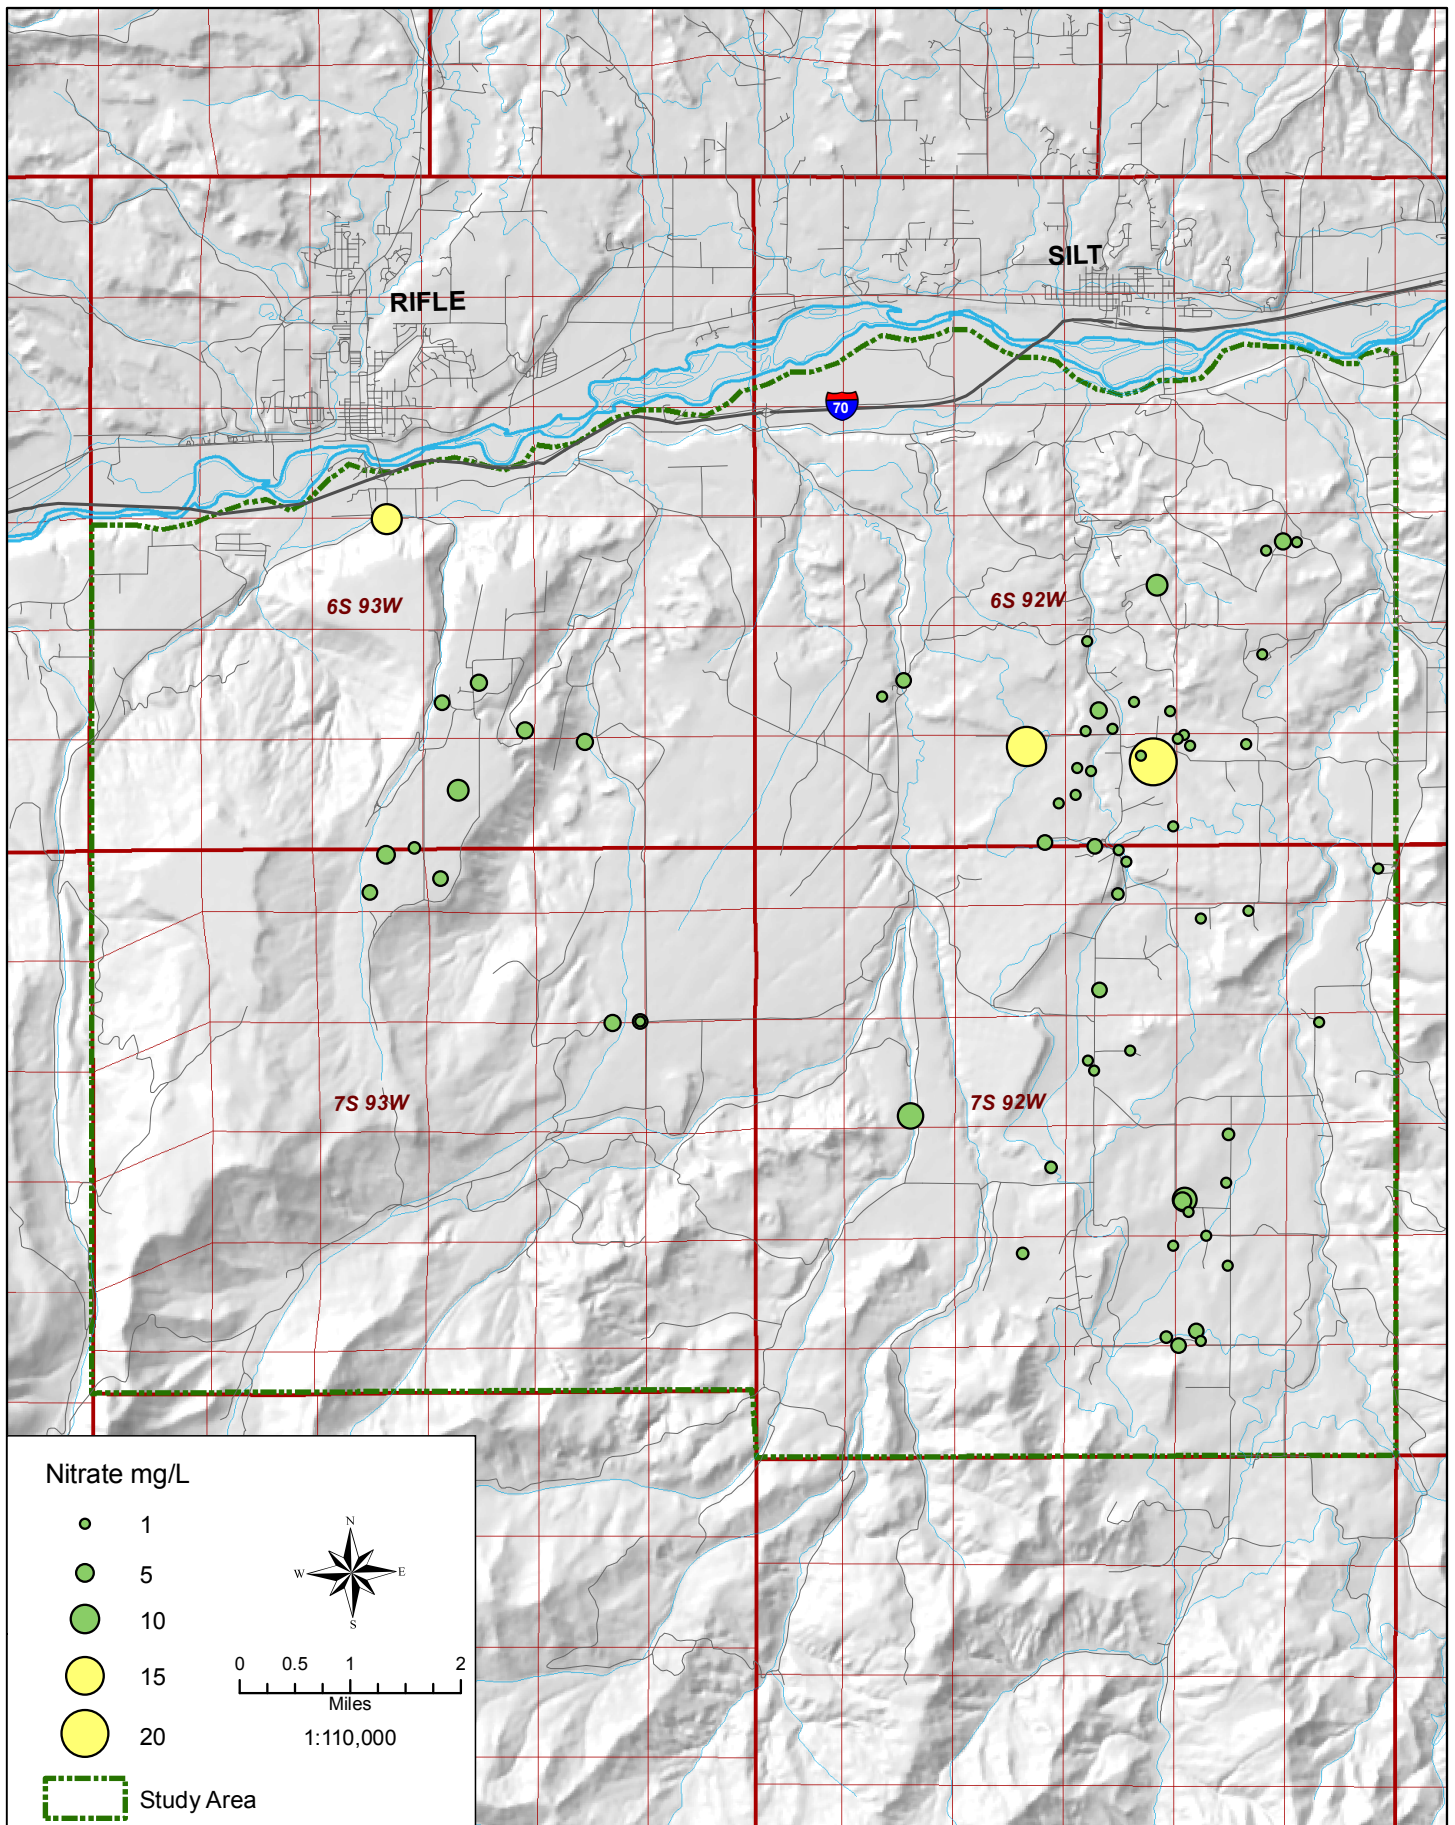

Note: Values > CBGWS standard of 10 mg/L are highlighted in yellow.

Figure 4.3. Nitrate Concentration Distribution in Domestic Wells