


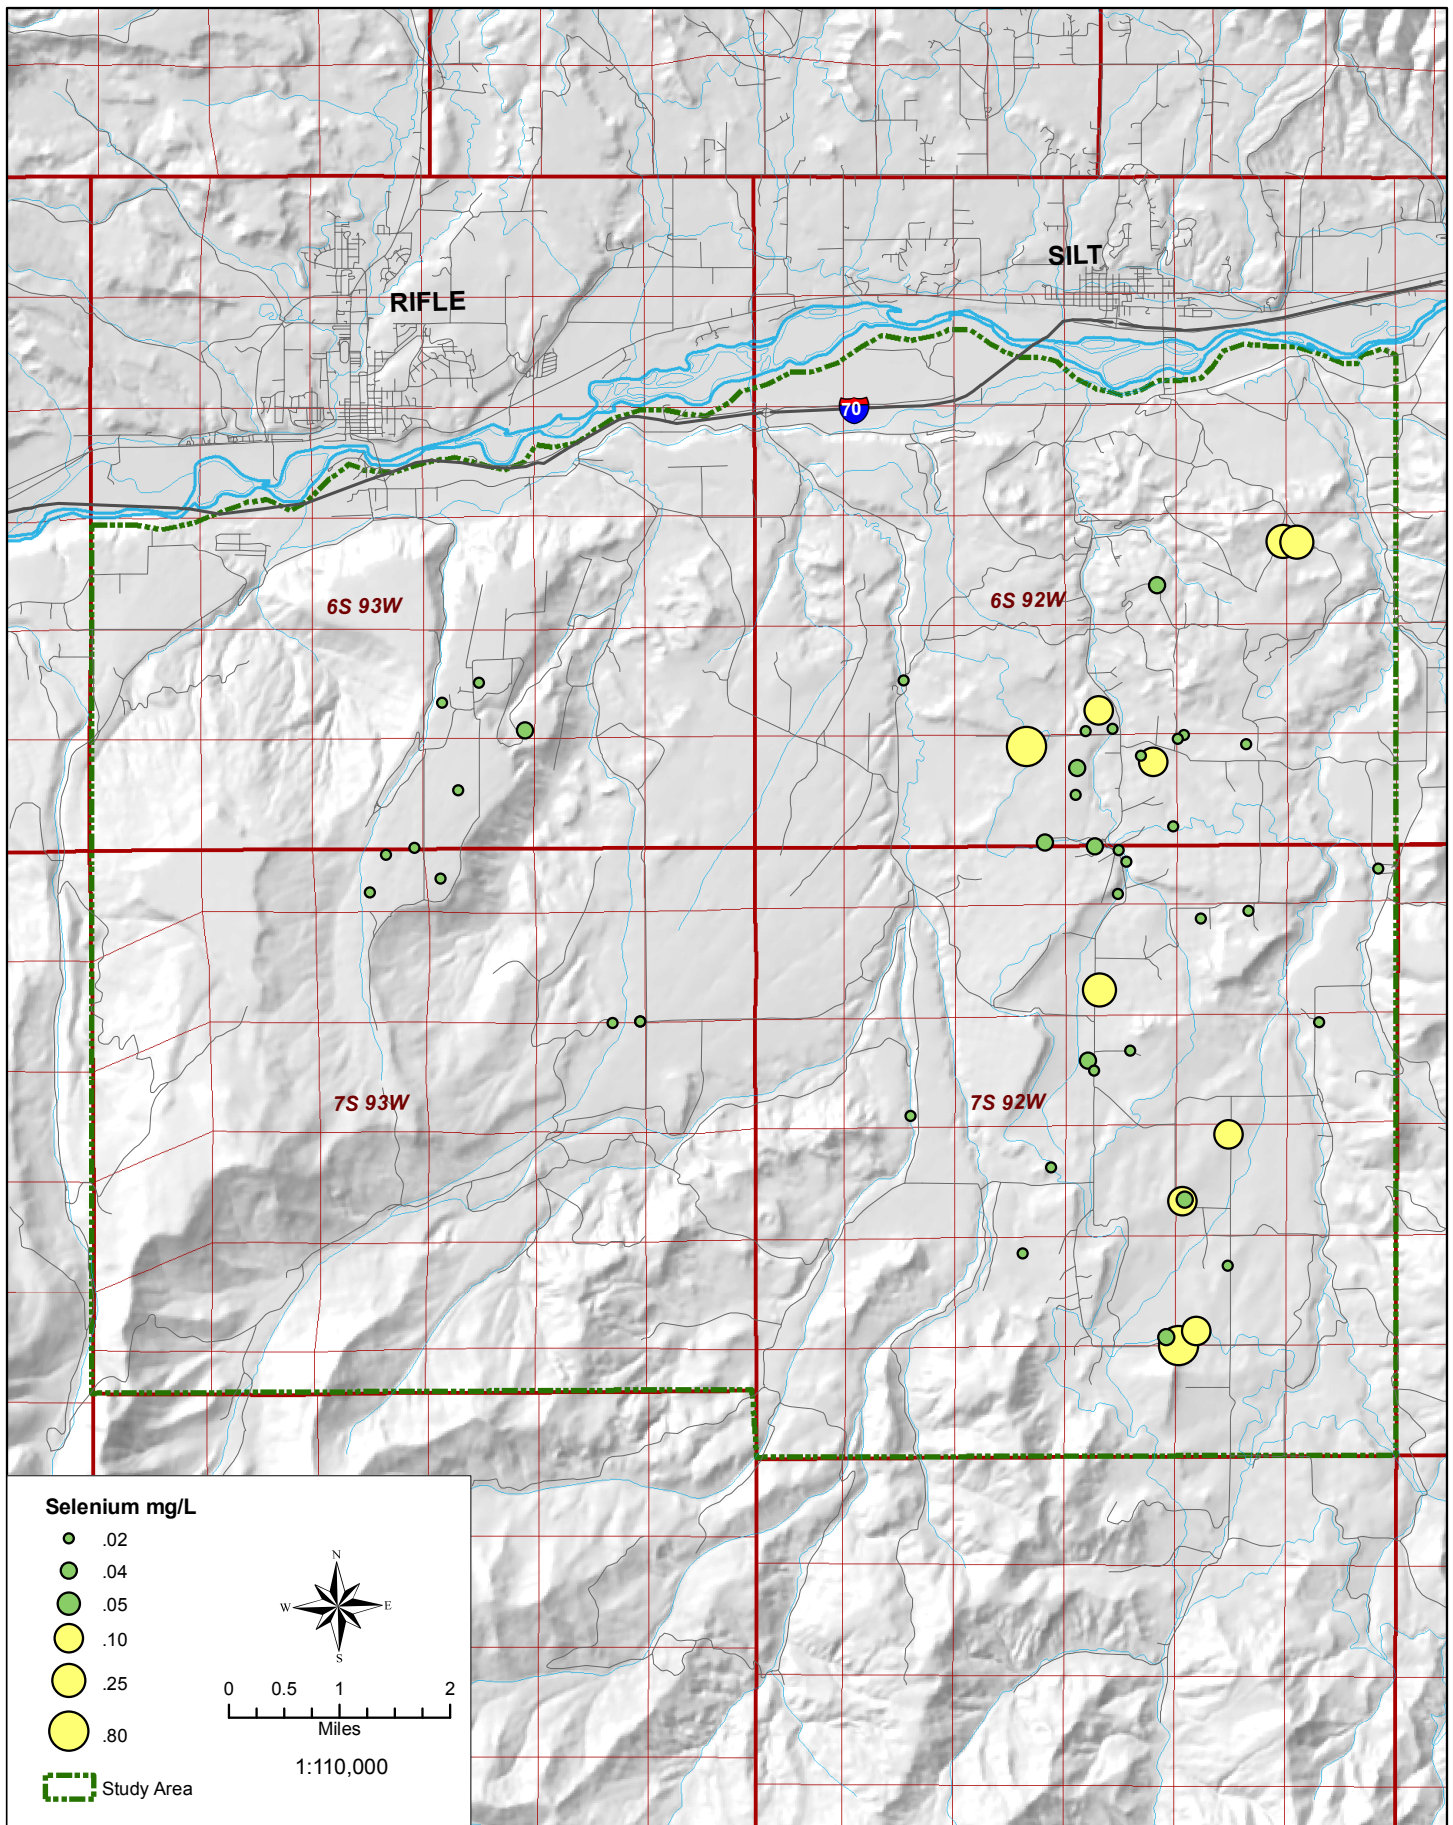

Note: Values > CBGWS standard of 0.05 mg/L are highlighted in yellow.

Figure 4.5. Selenium Concentration Distribution in Domestic Wells