


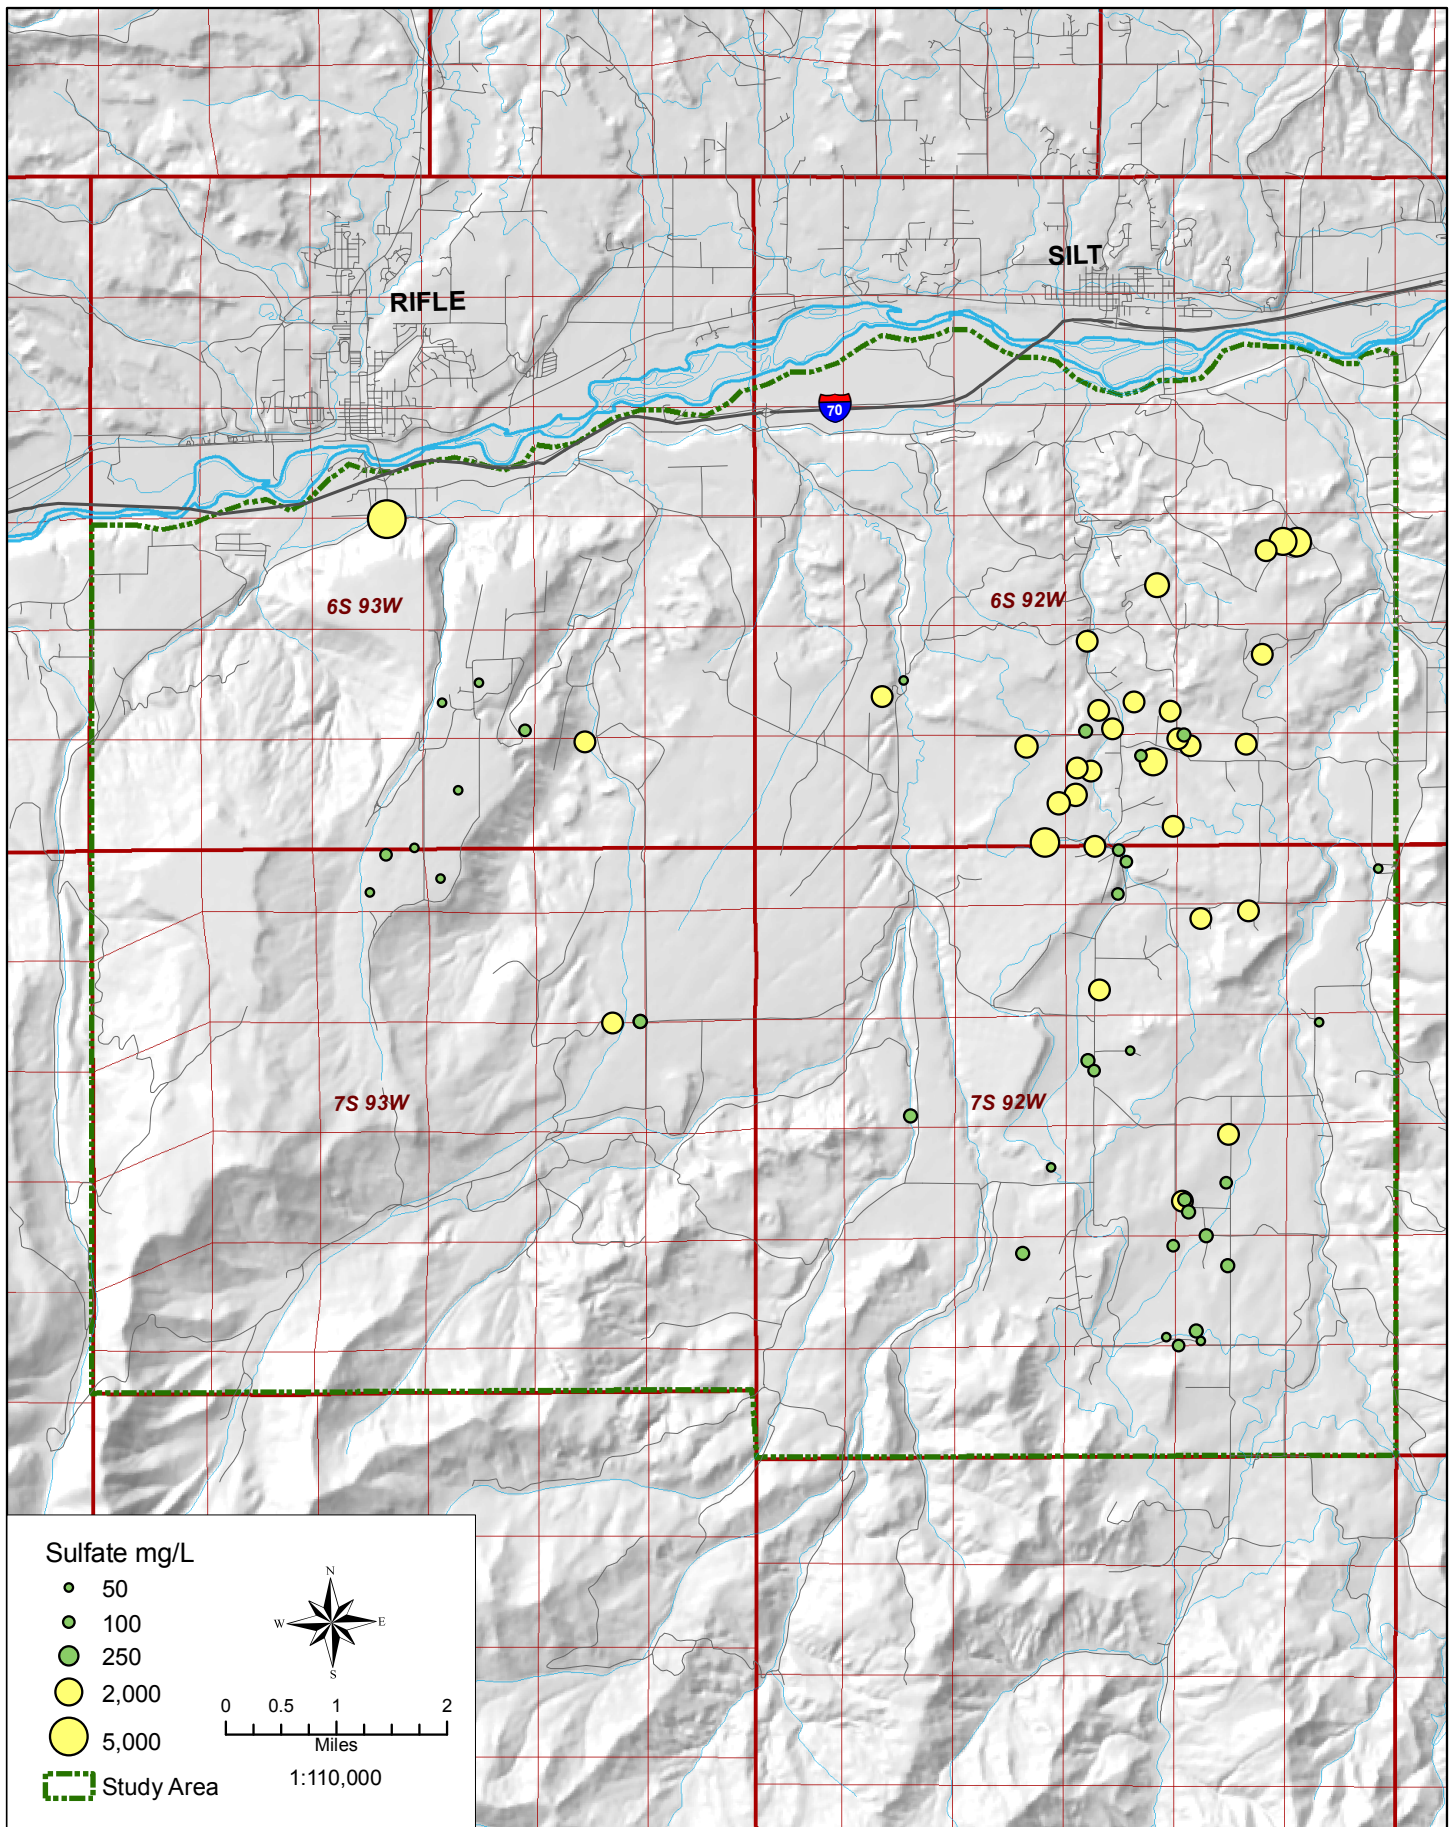

Note: Values > CBGWS standard of 250 mg/L are highlighted in yellow.

Figure 4.6. Sulfate Concentration Distribution in Domestic Wells